


RevN-	Revision Note	Date	Signature
0	INITIAL RELEASE	3/05/04	AVD

**** IMPORTANT ****
INSURE ELECTRICAL POWER IS OFF TO ELECTRICAL BOX BEFORE PROCEEDING!
MINIMUM 90° EC SUPPLY CONDUCTORS

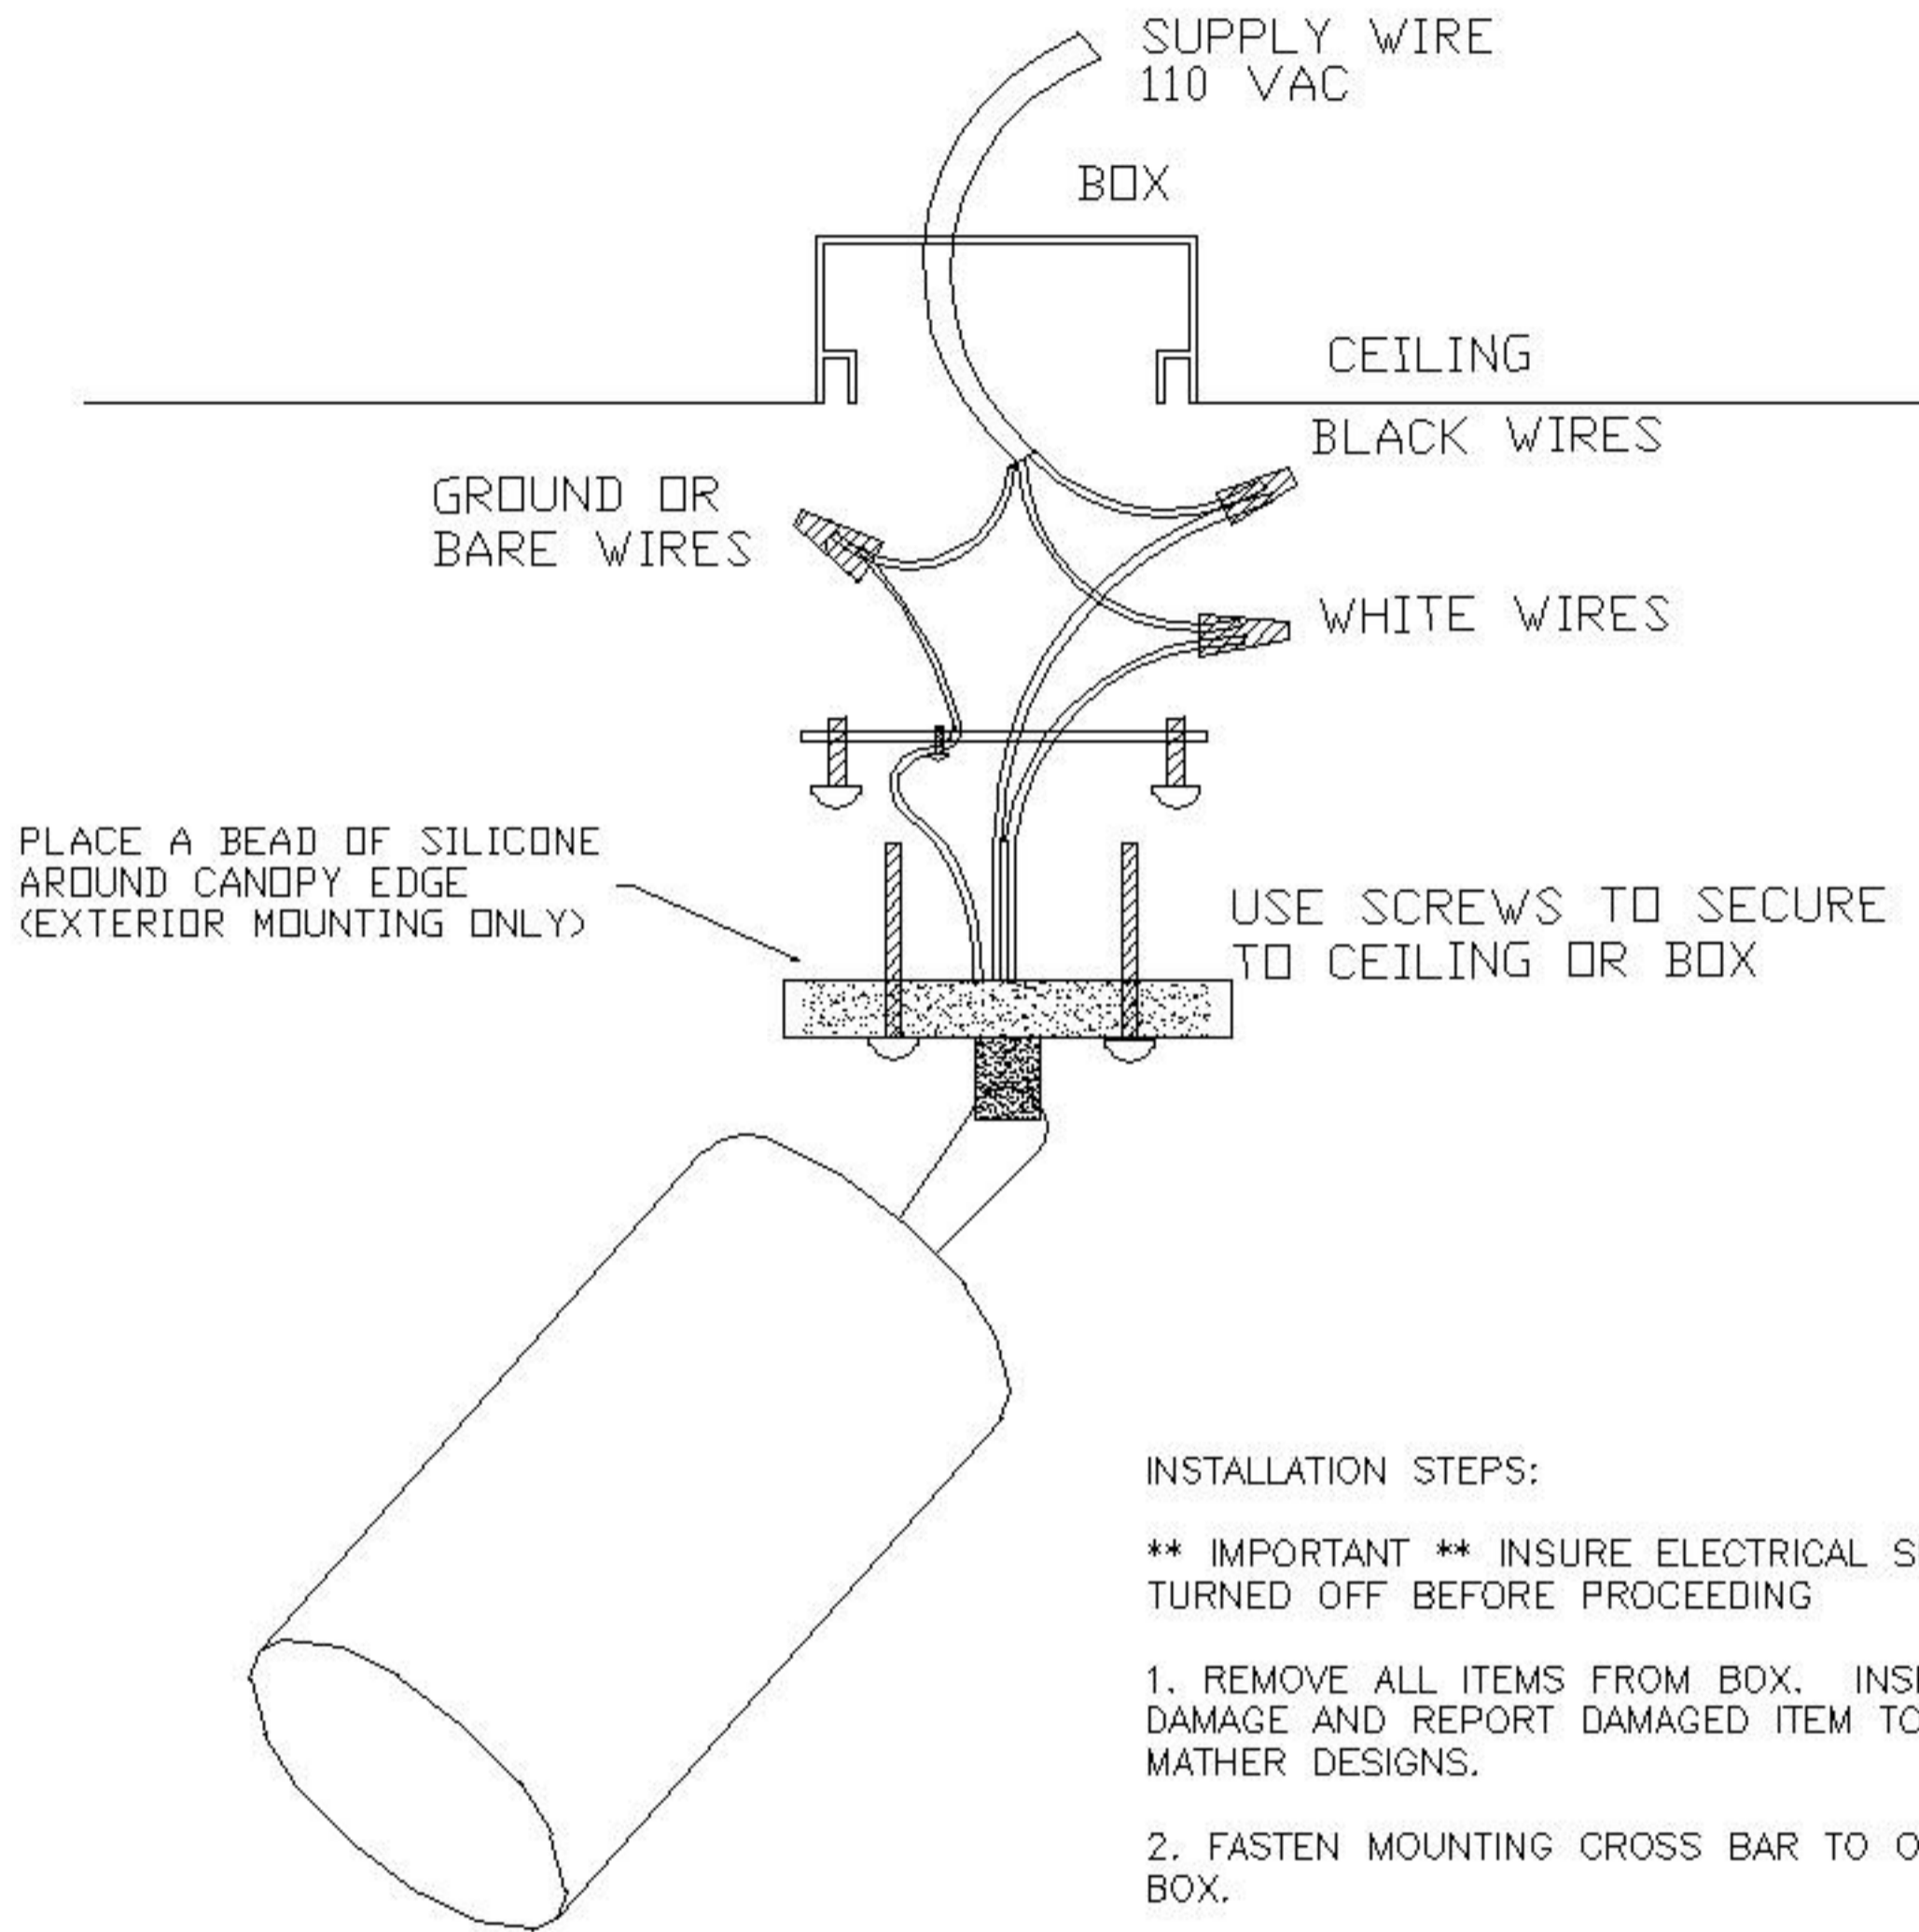

INSTALLATION STEPS:

- ** IMPORTANT **** INSURE ELECTRICAL SERVICE IS TURNED OFF BEFORE PROCEEDING
1. REMOVE ALL ITEMS FROM BOX. INSPECT FOR DAMAGE AND REPORT DAMAGED ITEM TO STONE MATHER DESIGNS.
 2. FASTEN MOUNTING CROSS BAR TO OUTLET BOX.
 3. CONNECT WHITE WIRE WITH WHITE SUPPLY WIRE AND CONNECT BLACK WIRE WITH BLACK SUPPLY WIRE USING WIRE NUTS.
 4. LOOP BARE COPPER GROUNDING WIRE AROUND GROUND SCREW ON CROSS BAR AND TIGHTEN. CONNECT GROUNDING WIRE FROM OUTLET BOX WITH BARE COPPER GROUNDING WIRE FROM FIXTURE USING WIRE NUT.
 5. PLACE A BEAD OF SILICONE SEALANT AROUND CANOPY EDGE (FOR EXTERIOR MOUNTING ONLY)
 6. THREAD SCREWS FROM CANOPY INTO CROSSBAR BRACKET AND TIGHTEN TO SECURE TO WALL OR CEILING.

THIS PRODUCT MUST BE INSTALLED IN ACCORDANCE WITH THE APPLICABLE INSTALLATION CODE BY A PERSON FAMILIAR WITH THE CONSTRUCTION AND OPERATION OF THE PRODUCT AND THE HAZARDS INVOLVED AND OR A QUALIFIED ELECTRICIAN.

UNDERWRITERS LABORATORIES COMPLIANCE	<p align="center">STONE MATHER DESIGNS 4444 Tower Rd. SW Albuquerque, NM 87121 Phone (505) 247-4276 Fax (505) 247-4538</p>	INSTALLATION INSTRUCTIONS		
<p>UL</p> <p>1. INCANDESCENT FILE #E170691 2. FLUORESCENT FILE #E172522</p>		<p align="center">SPOT LIGHT CYLINDER SP, WSP</p>		
		Date 3/5/2004	Designed by AVD	Sheet 1/1